

Installation Detail

If your proposed installation details differ from that shown here, please discuss this with the authority having jurisdiction, referencing this documentation.

Deviation from this drawing requires approval of the relevant authority.

Connecting ductwork omitted for clarity. Ductwork must be independently supported. There must be an appropriate break-away joint between the damper and the connecting ductwork on both sides of the installation.

A minimum of 200mm between fire dampers installed in separate ducts and 75mm between fire damper and construction elements/edges needs to be observed unless otherwise specified in the drawing.

2x2 multiple damper array shown, drawing also applies to 1x2 and 2x1 multiple damper arrays.



SCAN ME

Please refer to the DoP for latest classifications for CE/UKCA compliance and the Installation, Operation and Maintenance Guide

C	ECN2374	MJB	11-09-24
B	ECN2281	JPM	22-06-23
A	Initial release	JPM	29-04-22
Rev:	Comments:	By:	Date:
Drawn By:	M. Bushell	Date:	30/03/2022
Checked By:	M. Kimberley	Date:	20/08/2024
Approved By:	S. Gore	Date:	27/08/2024

Description:
VERTICAL APPLICATION
MULTIPLE SS DWFX-F IN
EUROBOND FIREMASTER EXTRA
100mm COMPOSITE WALL
Damper Size Range (mm)
200 x 2045 to 200 x 2070



Reference No:	Sheet	Rev
AAF13397	1 of 2	C

Installation Detail

If your proposed installation details differ from that shown here, please discuss this with the authority having jurisdiction, referencing this documentation.

Deviation from this drawing requires approval of the relevant authority.

Connecting ductwork omitted for clarity. Ductwork must be independently supported. There must be an appropriate break-away joint between the damper and the connecting ductwork on both sides of the installation.

A minimum of 200mm between fire dampers installed in separate ducts and 75mm between fire damper and construction elements/edges needs to be observed unless otherwise specified in the drawing.

2x2 multiple damper array shown, drawing also applies to 1x2 and 2x1 multiple damper arrays.



SCAN ME

Please refer to the DoP for latest classifications for CE/UKCA compliance and the Installation, Operation and Maintenance Guide



C	ECN2374	MJB	11-09-24
B	ECN2281	JPM	22-06-23
A	Initial release	JPM	29-04-22
Rev:	Comments:	By:	Date:
Drawn By:	M. Bushell	Date:	30/03/2022
Checked By:	M. Kimberley	Date:	20/08/2024
Approved By:	S. Gore	Date:	27/08/2024

Description:
VERTICAL APPLICATION
MULTIPLE SS DWFX-F IN
EUROBOND FIREMASTER EXTRA
100mm COMPOSITE WALL
Damper Size Range (mm)
200 x 2045 to 200 x 2070

Reference No:	Sheet	Rev
AAF13397	2 of 2	C



Section D

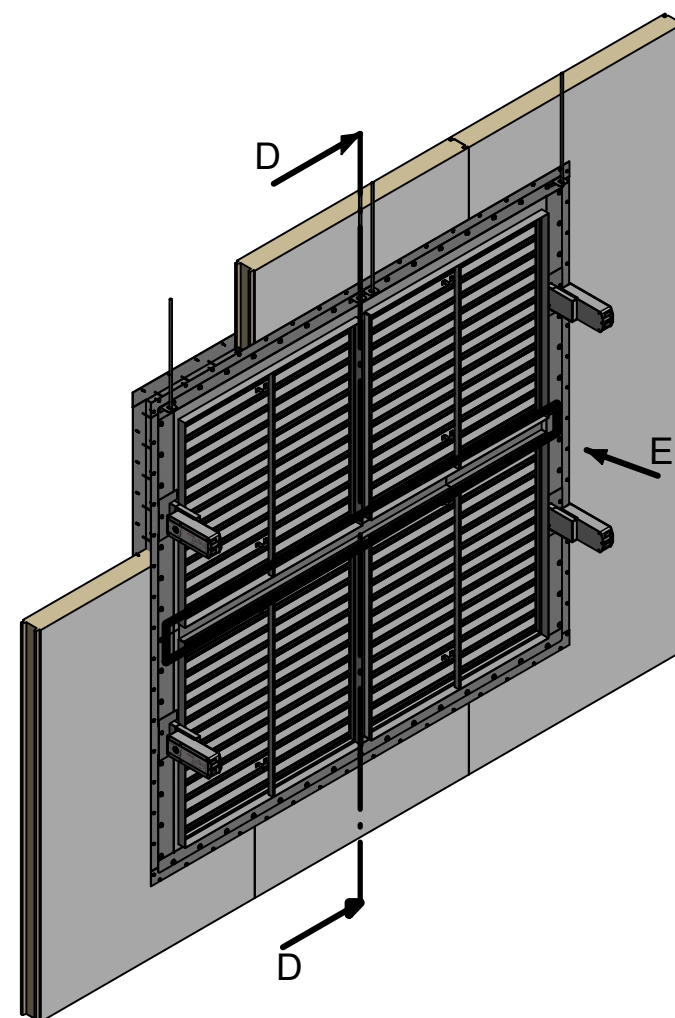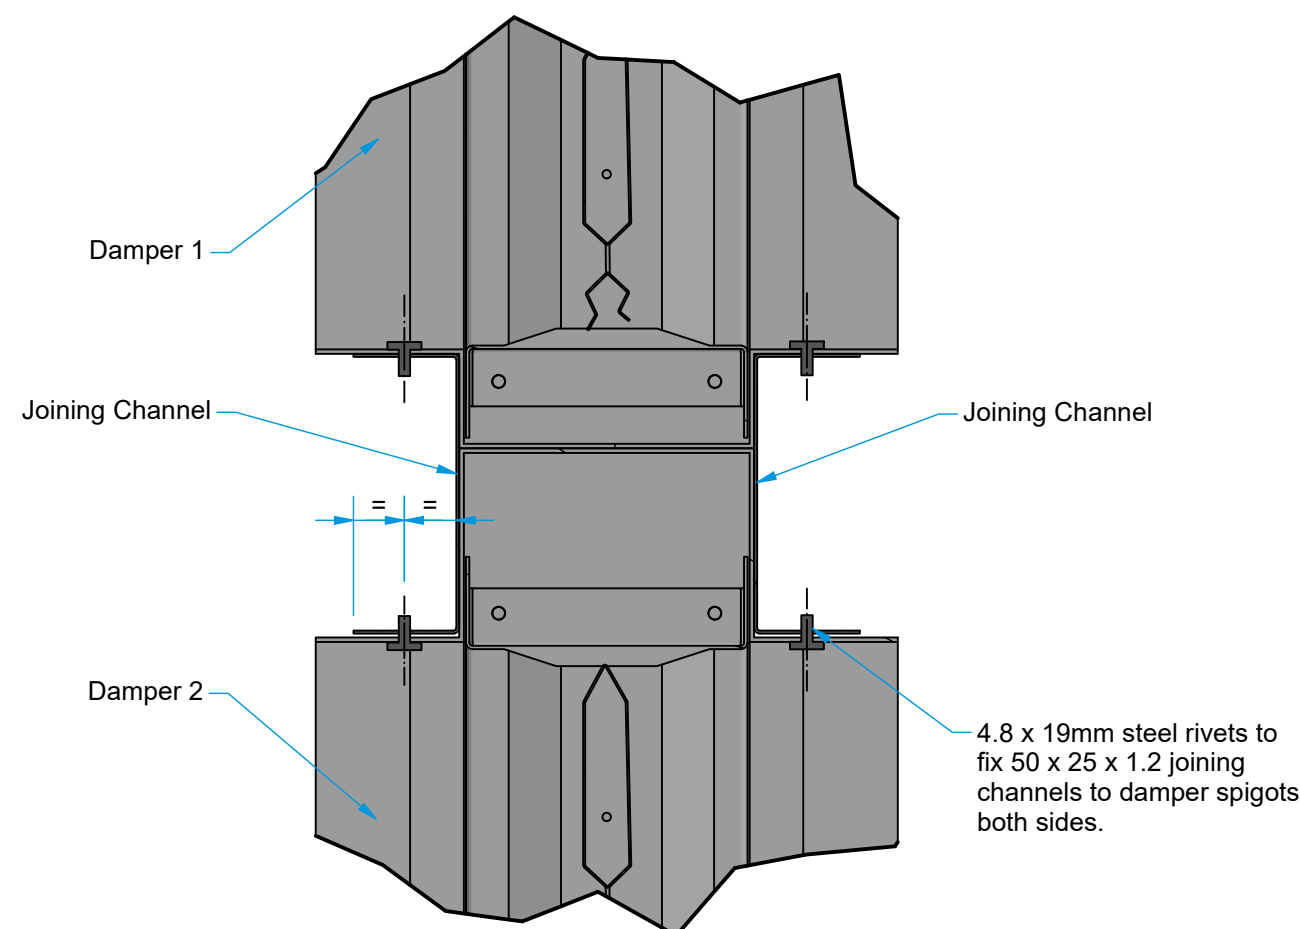

Detail E

