

GOLD SD 14-35 eff.var. 1 och 2/cap.var. 1 and 2, 40 eff.var./cap. var. 1


Med styrenhet/With control unit

Skiss visar styrenhet för aggregat med inspektionssida vänster, styrenhet för aggregat med inspektionssida höger ser något annorlunda ut, men principen är lika./

The sketch shows control unit for AHU with left-hand inspection, control unit for AHU with right-hand inspection looks slightly different, but the principle is the same.

Temperaturgivare för
densitetskorrigerat
luftflöde./
Temperature sensor
for density-corrected
airflow.

Om aggregatuppställning
innehåller batterivärme-
återvinnare är utempe-
raturgivare monterad
mellan filter och batte-
rivärmeåtervinnare/
If the unit contains heat
recovery coil, the outdoor
temperature sensor is
fitted between the filter
and the heat recovery coil

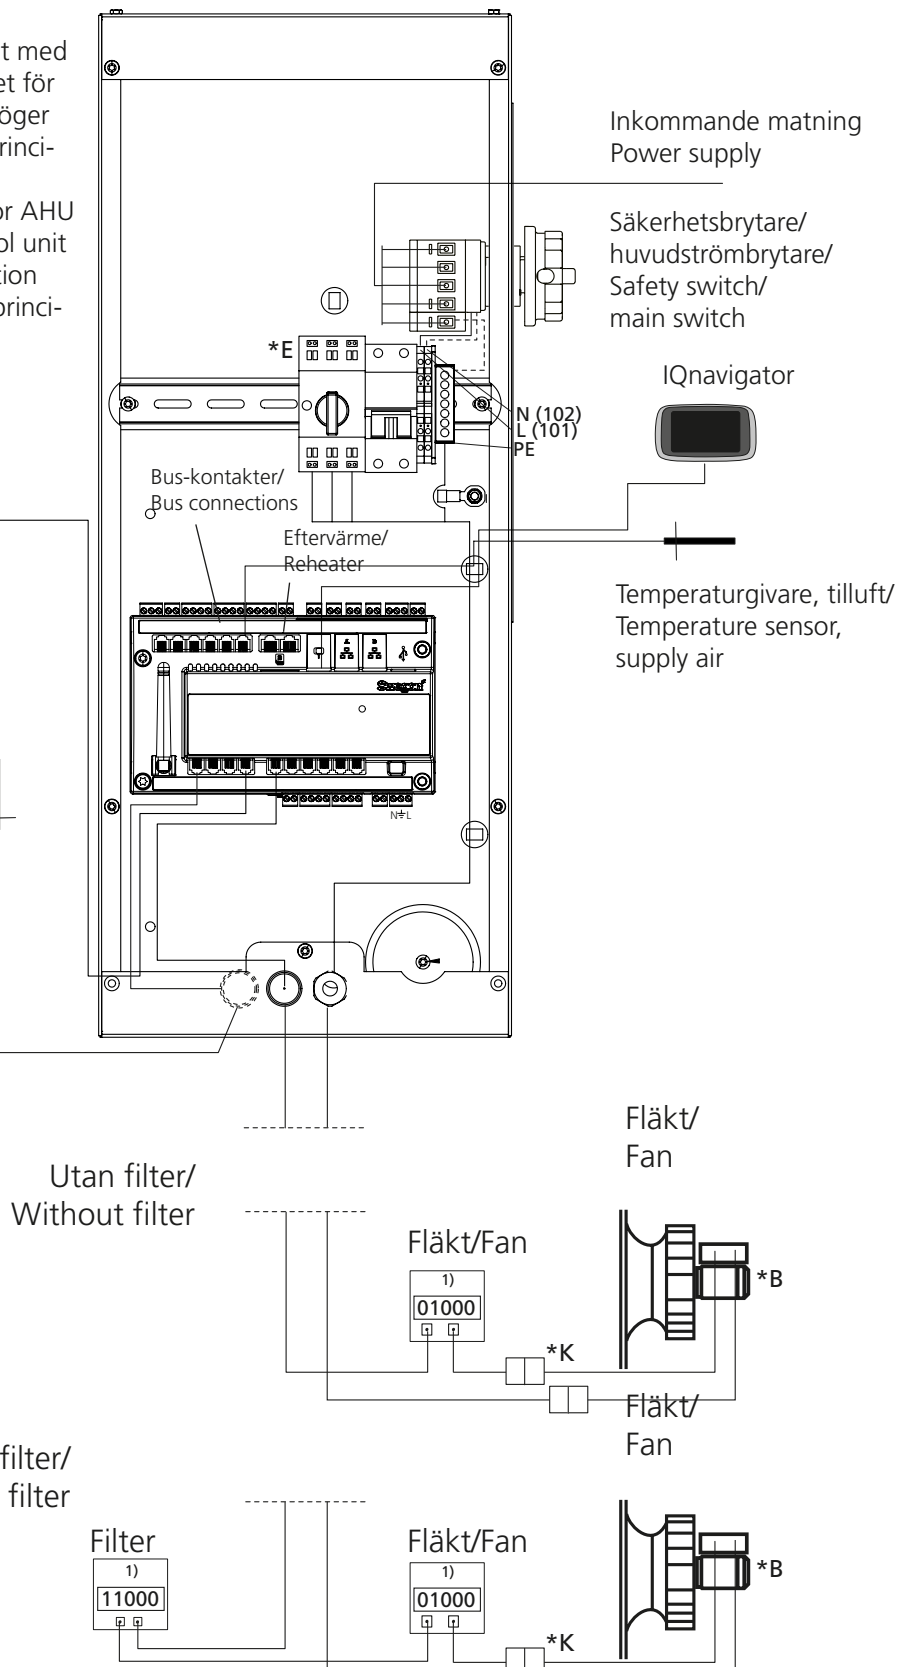


1) Inställning DIP-switch. Switch nr. 1-5. 1 = On, 0 = Off./
Settings DIP switch. Switch no. 1-5. 1 = On, 0 = Off.

Utan styrenhet/Without control unit

GOLD SD 14-35 eff.var. 1 och 2/cap.var. 1 and 2, 40 eff.var./cap. var. 1

Sammankoppling av aggregat med styrenhet
till aggregat utan styrenhet/

Connecting AHU with control unit to AHU without control unit

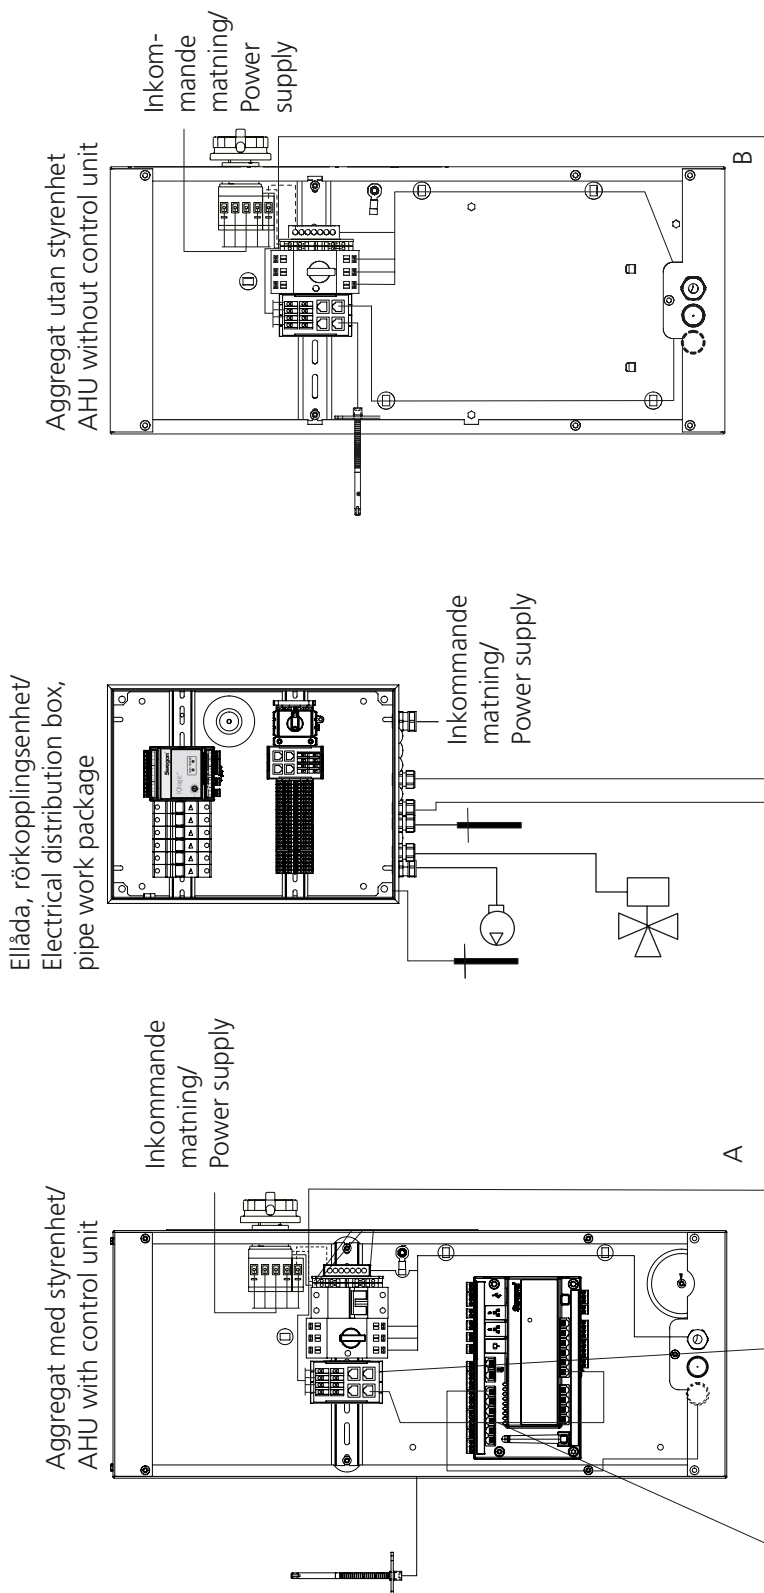


Partvinnad kommunikationskabel B min. 4x0,5 mm²
(Max totallängd kommunikationskabel A + B = 100
meter. Ingår ej i leverans)/
Twisted-pair communication cable B min. 4x0,5
mm² (Max total length communication cables A + B
= 100 meters. Not included in delivery)

Kommunikationskabel B kan även anslutas på
kabeladapter i ellådan på aggregatet med styrenhet
om det underlättar installationen./
If it simplifies the installation, the communication
cable B can also be connected to the cable adapter
in the electrical distribution box of the AHU with
control unit.


Partvinnad kommunikations-
kabel A min. 4x0,5 mm² (Max
totallängd kommunikationska-
bel A + B = 100 meter. Ingår ej
i leverans)/
Twisted-pair communication
cable A min. 4x0,5 mm² (Max
total length communication
cables A + B = 100 meters.
Not included in delivery)

Kabeladapter för
montering i el-
låda med styren-
het levereras löst
i ellådan utan
styrenhet/
Cable adapter for
mounting in elec-
trical distribu-
tion box with control
unit is delivered
unmounted in the
electrical distribu-
tion box without
control unit


B: Alt. 1: GOLD RX/PX/CX/SD14-120

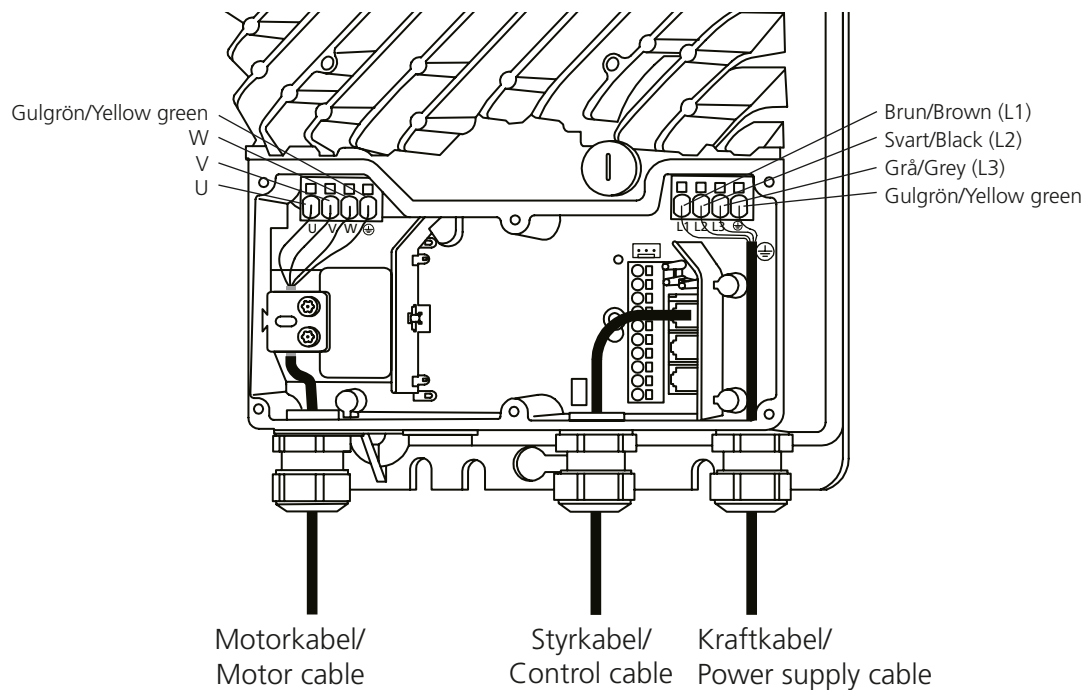


Alt. 2: GOLD RX/PX/CX/SD14-120

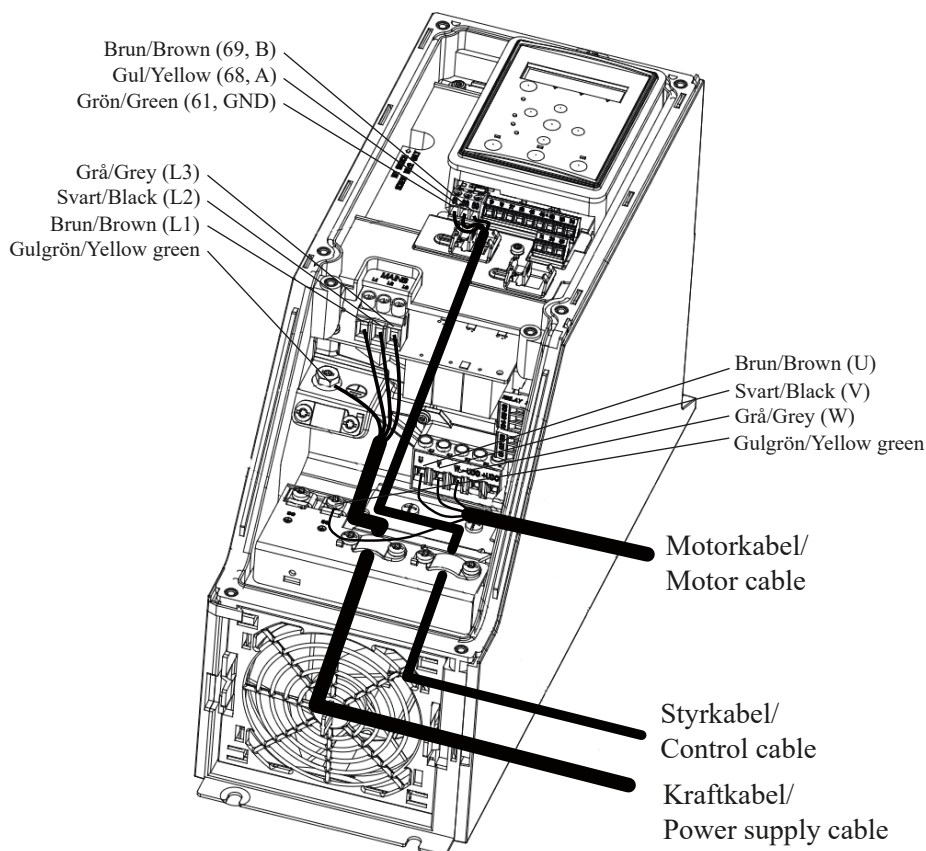

E: GOLD RX/PX/CX/SD 08/11 eff.var./cap.var. 2, 12-120

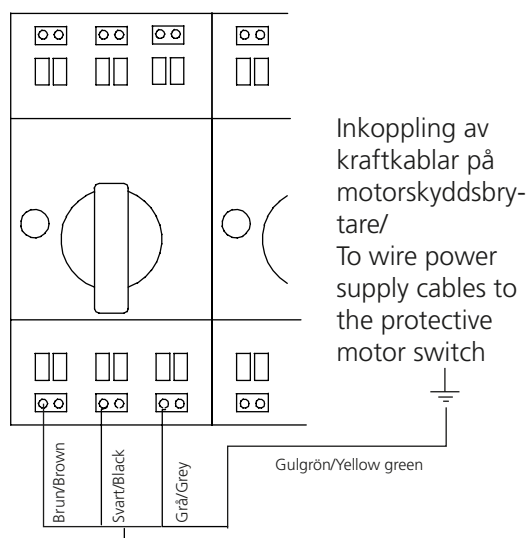

J: GOLD RX/PX/CX/SD 04-50

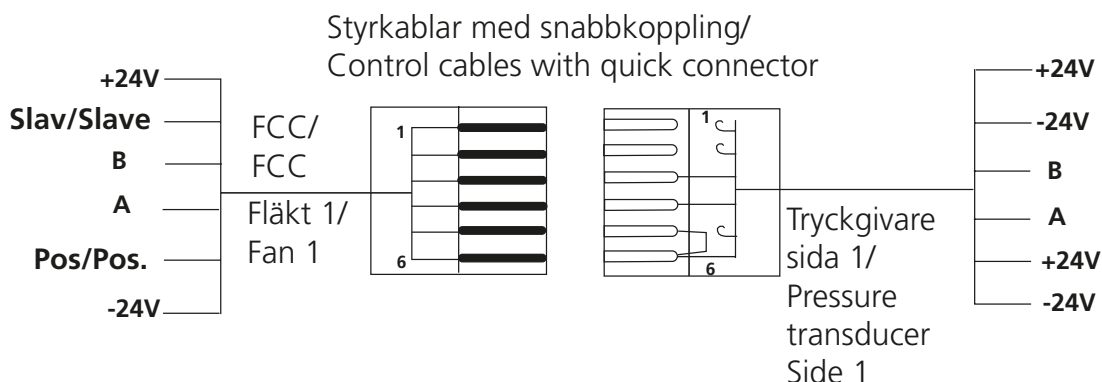

K: GOLD RX/PX/CX/SD 04-50

